

Batteries

Batteries are a key component in a grid-tie with back-up or a stand-alone renewable energy system that all of the other components rely on for operation. Without proper maintenance, batteries can fail prematurely and shut the whole system down. However, toiling over your battery bank with a voltmeter, hydrometer and a gallon of distilled water every day is not necessary. With simple monthly and quarterly maintenance procedures, your batteries should last for a long time. On the other hand, neglecting your batteries can drastically shorten their life span. The following statement sums it up best, "few batteries die a natural death, most are murdered". The following information is designed to tell you how to get the longest life and best performance possible from your battery bank. Most of this information is for flooded cell lead-acid batteries; alkaline (Ni-FE & Ni-Cad) and sealed gel-cell battery charging characteristics are completely different.

Battery Types Used in Solar Systems

There are three types of batteries that are most popularly used in solar electric systems. Each type has its pluses and minuses, so we will also include the systems the individual types are best suited for.

Flooded Lead Acid

Flooded lead acid batteries have the longest track record in solar electric use and are still used in the majority of standalone solar systems. They have the longest life and the least cost per amp-hour of any of the choices. However the other side of the coin is, in order to enjoy these advantages, they require regular maintenance in the form of watering, equalizing charges and keeping the top and terminals clean. Some examples of flooded lead-acid batteries used in solar electric systems are 6 volt golf-cart batteries, 6 volt L-16's and 2 volt industrial cells for large systems.

Absorbed Glass Mat Sealed Lead Acid (AGM)

AGM batteries are seeing more and more use in solar electric systems as their price comes down and as more systems are getting installed that need to be maintenance free. This makes them ideally suited for use in grid-tied solar systems with battery back-up. Because they are completely sealed they can't be spilled, do not need periodic watering, and emit no corrosive fumes, the electrolyte will not stratify and no equalization charging is required. AGM's are also well suited to systems that get infrequent use as they typically have less than a 2% self discharge rate during transport and storage. They can also be transported



easily and safely by air. Last, but not least, they can be mounted on their side or end and are extremely vibration resistant. AGM's come in most popular battery sizes and are even available in large 2 volt cells for the ultimate in low maintenance large system storage.

When first introduced, because of their high cost, AGM's were mostly used in commercial installations where maintenance was impossible or more expensive than the price of the batteries. Now that the cost is coming down they are seeing use in all types of solar systems as some of today's owners think the advantages outweigh the price difference and maintenance requirements of flooded lead acid batteries.

Gelled Electrolyte Sealed Lead Acid

Gelled lead acid batteries actually predated the AGM type but are losing market share to the AGM's. They have many of the same advantages over flooded lead acid batteries including ease of transportation, as the AGM type, except the gelled electrolyte in these batteries is highly viscous and recombination of the gases generated while charging, occurs at a much slower rate. This means that they typically have to be charged slower than either flooded lead acid or AGM batteries. In a solar electric system you have a fixed amount of sun hours every day and need to store every solar watt you can before the sun goes down. If charged at too high a rate, gas pockets form on the plates and force the gelled electrolyte away from the plates, decreasing the capacity until the gas finds its way to the top of the battery and is recombined with the electrolyte. For use in a grid-tie with back up system or any system where discharge rates are less than severe, gel batteries could be a good choice.

Think of your batteries like a bucket of energy

Batteries are simply a storage vessel for the direct current (DC) power produced from your charging sources (solar modules, wind generator, micro-hydro or generator/battery charger). If you aren't familiar with the water to electricity analogy, please read the Basics of Electricity section on page 10. If you don't have time to read that whole section, then just remember that pressure = voltage and flow rate = amperage. The size of the bucket determines how much water it will hold which is analogous to the amp-hour storage capacity of a battery (bigger, heavier batteries hold more energy like a larger bucket holds more water). If you connected a pressure gauge to the bottom of a bucket and started filling it with water you would see the pressure increase until the water reaches the top. The same holds true for a battery as you put amperage or current into it, the voltage level rises.

Deep Cycle vs. Shallow Cycle


In battery lingo, a cycle on your battery bank occurs when you discharge your battery and then charge it back up to the same level. A lead acid battery is designed to absorb and give up electricity by a reversible electrochemical reaction. How deep a battery is discharged is termed **depth of discharge (DOD)** while the **state of charge (SOC)** is 100% minus the DOD. This means that a 25% DOD equals a 75% SOC. A shallow cycle occurs when the top 20% or less of the battery's energy is discharged and then recharged. Automotive starting, lighting and ignition batteries (SLI) are of the **shallow cycle** type and are not recommended for use in a photovoltaic system. The lead plates inside an SLI battery are thin with a large overall surface area. This design can produce a high amount of current in a very short time (which is ideal for starting engines), but cannot be discharged very deeply without damaging them and/or shortening their life span considerably.

Deep cycle batteries on the other hand can be repeatedly discharged to 80% DOD and recharged without damaging them (although repeated deep cycling will shorten the battery's life as compared to the same number of shallow cycles). Deep cycle batteries have thicker lead plates which have less overall surface area as compared to an SLI battery. Because of the lessened availability of surface area for chemical reaction, deep cycle batteries produce less current than a shallow cycle battery but can produce that amount of current for a much longer period of time.

The depth of cycling has a good deal to do with determining a battery's useful life. Even batteries designed for deep cycling are "used up" faster as the depth of discharge is increased. It is common practice for a system to be designed with deep cycle batteries even though the daily or average discharging amounts to a relatively shallow depth of discharge. To get the longest life out of your battery bank, **purchase deep cycle batteries and shallow cycle them.**

Warm in the winter, Cool in the summer

The speed of the charging and discharging chemical reactions occurring inside a lead-acid battery is governed by temperature and charge/discharge current. The colder the temperature the slower the reactions and conversely the warmer the temperature the faster the reactions. Hence a cold battery will deliver less amperage in any given time frame as compared to a warm battery. Most of us have experienced this effect when trying to start our cars on a cold morning; the engine just doesn't turn over as quickly if at all. Warm that same battery up and you will see a major improvement. (See the bar graph of temperature effects below). The optimum temperature for a lead-acid battery is around 77°F, but 60-80°F is acceptable. For this reason we like to see batteries placed indoors or in a heated and ventilated space to maintain them between 60° to 80°F. If you do install them in an unheated space, battery capacity must be increased to compensate for this derating. On the other extreme, high temperatures (110°F+) can drastically shorten the life of the battery and should be avoided as well.

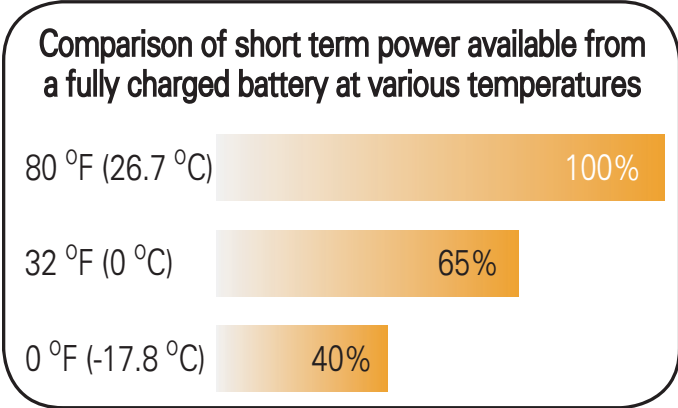

Batteries are not 100% efficient

Energy is never consumed or produced, it merely changes form. The efficiency of conversion is never 100% and in the case of new batteries averages around 90%. This means that if you want to discharge 100 watt-hours of energy from a battery you must charge it with approximately 110 watt-hours of energy.

Due to impurities in the chemicals used for battery construction, batteries will lose power to local action, an internal reaction which occurs whether you are using the battery or not. This slow discharging is termed self-discharge and it's rates vary greatly among battery types and increases along with temperature. The rate also increases with the age of a battery, so much so that an old battery may require significant amount of charging just to stay even. Even new batteries may lose 1 to 2% of charge per day. Lead calcium grid batteries have the lowest self-discharge rates, but are not designed for deep cycling applications.

Determining battery state of charge

Battery state of charge is determined by reading the static (i.e. not charging or discharging) battery voltage or the specific gravity of the electrolyte. The density or specific gravity of the sulfuric acid (H2SO4) electrolyte of a leadacid battery varies with the state of charge and temperature. The density is lower when the battery is discharged and higher as the cells are charged, (see the table below). This is because the electrolyte is part of the chemical reaction, it changes as the chemical reaction takes place. Specific gravity is read with a hydrometer which will tell the exact state of charge. A hydrometer cannot be used with sealed or gel-cell batteries.

Voltage meters are used to approximate battery state of charge. They are relatively inexpensive and easy to use. The main problem with relying on voltage reading alone is the high degree of battery voltage variation through the working day. Battery voltage reacts highly to charging and discharging. In a PV system we are usually charging or discharging and many times are doing both at the same time. As a battery is charged the indicated voltage increases and as discharging occurs, the indicated voltage decreases.

These variations may seem hard to track, but in reality they are not. A good accurate digital meter with a tenth of a volt accuracy can be used with success. The pushing and pulling of voltage, once accounted for by experience, can also help indicate the amount of charging or discharging that is taking place.

By comparing voltage readings to hydrometer readings, shutting off various charging sources or loads and watching the resulting voltage changes, the system owner can learn to use indicated voltage readings with good results.

Percentage of Charge	12 Volt Battery Voltage	24 Volt Battery Voltage	Specific Gravity
100	12.70	25.40	1.265
95	12.64	25.25	1.257
90	12.58	25.16	1.249
85	12.52	25.04	1.241
80	12.46	24.92	1.233
75	12.40	24.80	1.225
70	12.36	24.72	1.218
65	12.32	24.64	1.211
60	12.28	24.56	1.204
55	12.24	24.48	1.197
50	12.20	24.40	1.190
45	12.16	24.32	1.183
40	12.12	24.24	1.176
35	12.08	24.16	1.169
30	12.04	24.08	1.162
25	12.00	24.00	1.155
20	11.98	23.96	1.148
15	11.96	23.92	1.141
10	11.94	23.88	1.134
5	11.92	23.84	1.127
Discharged	11.90	23.80	1.120

Specific gravity values can vary + or -.015 points of the specified values. This table is for the Trojan L-16 battery in a static condition, no charging or discharging occurring, at 77 degrees F. Discharging or charging will vary these voltages substantially.

Source- Trojan Battery Company

Monitoring and Maintenance

Monitoring battery state of charge is the single largest responsibility of the system owner. The battery voltage should be kept at or above a 50% state of charge at all times for maximum battery life (see the battery voltage table). Be sure to keep the battery's electrolyte level at the marked full level and never let the plates become exposed to the air. When refilling the batteries, use only distilled water - not tap water. Water is the only element used by your battery, you should never have to add additional acid to your battery. Do not over fill the batteries or fill when the batteries are discharged. Over watering dilutes the acid excessively and electrolyte will be expelled when charging.

As batteries are charged they create bubbles of gas, produced when the chemical reaction cannot keep up with the energy input. Some gassing is necessary in flooded cell batteries. The amount and duration of gassing varies from one battery to another. Gassing mixes the electrolyte and compensates for the tendency of the electrolyte to stratify with the more dense acid on the bottom. Gassing is the product of splitting water molecules into hydrogen and oxygen. This consumes water and creates the need for its periodic replacement.

Battery Gassing

A slight acid mist is formed as the electrolyte bubbles upon charging. This mist is highly corrosive, especially to the metallic connectors on the tops of the batteries. Inspect for corrosion and carefully clean these periodically as needed with baking soda and water. Be sure not to get any baking soda into the battery electrolyte as it will have a neutralizing effect. Corrosion buildup can create a good deal of electrical resistance, which can contribute to shortened battery life and the waste of power. It's always a good idea to wear goggles and protective gear (goggles, rubber gloves and apron) when working on your batteries as the sulfuric acid can seriously damage your eyes and eat holes in your clothes.

Equalization is a controlled overcharging of a fully charged battery. This overcharge mixes the electrolyte, evens the charge among varying battery cells and reduces permanent sulfation of the battery plates. It is energy invested in lengthening the life of the battery. Though the PV system

Equalization (EQ)

battery bank receives a good deal of cycling and gassing through normal activity, equalization is a complement to this activity and as a rule of thumb should be done every 60 to 90 days. The equalization process consumes water and produces much gassing, so your batteries should be well ventilated during this charging. Equalization charging voltages vary widely, as do duration times, so the batteries should be monitored closely during this process. Check periodically during the EQ process. You don't have to check every cell each time, but watch any that show a high variation from the rest of the cells. Keep checking the specific gravity of the electrolyte until you receive three readings of 30 minutes apart which indicate no further increase of specific gravity values. Keep a record of individual cell voltages and specific gravity before and after equalizing. Equalization will take your voltage to 15 volts or higher (30 volts on a 24 volt system) so make sure any DC loads are disconnected before you begin.

The connections from battery to battery and on to the charging and load circuits are critical. Before connecting your batteries together, be sure that the interconnects and battery terminals are clean. When making your series and parallel battery connections, be careful not to torque the connecting hardware too tight as the battery's lead posts can break easily. After all battery connections are made, go back to each battery terminal and apply anti-corrosion coating or grease to minimize corrosion build up. Torquing all bolts equally avoids variations in resistance. This variation in resistance is the main reason we prefer to minimize the number of parallel strings in the bank. Higher resistance values on one string of batteries result in less charge to that string and consequently shorter life. We also place the main negative and positive on opposing corners of the battery bank. The goal is to keep the variation of resistance from one parallel string to another to a minimum.

Battery Connections

Used Batteries

Like most things, you get what you pay for. Used lead acid batteries, especially large two volt telephone type cells can be found for sale at some very attractive prices. While used solar modules and inverters are usually an acceptable risk, used batteries are not. Should you consider them? In our experience it is difficult to know just how an older battery has been used and cared for. Our recommendation on used batteries is to inspect them carefully in person, get as much information as you can on them (manufacturer, age, amp-hour capacity and type

of system they were used in) and have them load tested. Without load testing used batteries you are really guessing as to their remaining life. If you are considering telephone cells, realize that they are normally shallow cycle lead calcium grid construction, and should not be used in a system designed for deep cycling.

DON'T SKIMP ON BATTERIES!

A correctly sized battery bank is vital to the proper functioning of your system. Compromising on the battery bank can lead to poor performance and dissatisfaction with the entire system. Do not skimp here.

Rolls

Deep cycle, flooded lead-antimony batteries feature a high cycle life, thick plates, a large liquid reserve, and a ten year warranty. Dry charged models for export are available. Rolls Battery Engineering has been manufacturing the highest quality deep cycle lead-acid batteries for more than 60 years. Their series 5000 system of batteries has been manufactured specifically for renewable energy applications and are designed to offer up to a 20 year lifetime.

- Non-Breakable dual container construction which prevents acid leakage
- Thick lead plates with the highest density active material which provides unsurpassed cycling service
- Increased liquid reserve which means less maintenance
- 3000+ cycles to 50% depth of discharge, 2000+ cycles to 80% depth of discharge
- Ten year (first 36 months full; next 84 months pro-rated) warranty



Rolls 6CS-21PS

Product Name and Description	Part Number	Voltage	Amp Hour (20/100 Hr. Rate)	Size (in.) (L x W x H)	Price	Shipping Weight (lbs.)
2-KS-33PS	705191	2	1,750 / 2,470	13.75 x 8.25 x 24.81	\$1,184.00	208.0
4-KS-21PS	705190	4	1,104 / 1,557	15.75 x 9.75 x 24.75	\$1,703.00	230.0
4-KS-25PS	703091	4	1350 / 1,900	15.75 x 10.63 x 24.75	\$2,130.00	315.0
6-CS-17PS	703121	6	546 / 770	22.0 x 8.25 x 18.25	\$1,316.00	221.0
6-CS-21PS	703123	6	683 / 963	22.0 x 9.75 x 18.25	\$1,643.00	271.0
6-CS-25PS	703122	6	820 / 1156	22.0 x 11.25 x 18.25	\$1,905.00	318.0

L-16 Solar Batteries

Series 4000 battery is recommended for many medium sized PV systems. It is rated 350 to 400 amp-hours at 6 volts. Their lead plates are heavier than those in 6 volt golf cart batteries. This heavier construction increases the useful life of the battery while keeping initial costs low, making this a good battery to choose for a medium size system. Multiples of two required on 12 volt systems. Multiples of four required on 24 volt systems. Seven year (first 24 months full; next 60 months pro-rated) warranty.



Rolls S-460

Product Name and Description	Part Number	Amp Hour (20/100 Hr. Rate)	Size (in.) (L x W x H)	Price	Shipping Weight (lbs.)
Surette S-460	703120	350 / 460	12.3 x 7.125 x 16.75	\$484.00	117.0
Surette S-530	703118	400 / 530	12.3 x 7.125 x 16.75	\$550.00	127.0

MK Solar Batteries

MK Gel Cell Batteries

The Deka Solar Series of valve-regulated, gelled-electrolyte batteries are designed to offer reliable power for renewable energy applications where frequent deep cycles are required and minimum maintenance is desired. These batteries are sealed, but will vent at a pressure of 2 psi while being charged. Therefore, they require a ventilated enclosure to prevent gas build up. Maximum charging voltage should be at least 13.8 volts, but no more than 14.1 volts at 68°F. Two year warranty (One full and one pro-rated). We recommend these batteries for small to medium sized PV systems, from recreational vehicles to remote telecommunication sites.



MK Solar Batteries

MK Power-Tech Batteries

Power-Tech Batteries are specially designed for the long, deep discharges typical of marine, wheelchair, RVs, emergency lighting, golf cars, other deep cycle applications as well as engine starting. The absorbed glass mat (AGM) design provides maintenance-free service and insures that the Power-Tech Batteries are spill proof and leakproof.

More Features:

- Valve-regulated
- Gelled-electrolyte or Absorbed Glass Mat
- Compucast, power path grids are computer controlled oxide
- Low standing loss (less than 2%)
- Tank formed plates
- Rated non-spillable by ICAO, IATA and DOT
- Lead calcium construction
- Sealed construction eliminates periodic watering, corrosive acid fumes and spills.
- Electrolyte will not stratify, no equalization charging required.
- Increases durability and deep-cycle ability for heavy demand applications.
- Insures voltage matching between cells.
- Transports easily and safely by air. No special containers needed.
- Insures reliable service, support and quality.
- Excellent cycling performance.

Product Name and Description	Part Number	Amp Hour (20/100 Hr. Rate)	Size (in.) (L x W x H)	Price	Shipping Weight (lbs.)
8GU1 Gel	703095	31.6 / 36.5	7.75 x 5.13 x 7.25	\$120.00	24.0
8G22NF Gel	703100	50.9 / 58.2	9.38 x 5.50 x 9.25	\$198.00	37.0
8G24 Gel	703096	73.6 / 84.0	10.25 x 6.75 x 9.88	\$270.00	53.0
8G27 Gel	703104	86.4 / 99.0	12.75 x 6.75 x 9.88	\$315.00	63.0
8G4D LTP Gel	703098	183.0 / 210.0	20.75 x 8.50 x 11.0	\$656.00	127.0
8G8D LTP (T975 Term)	703099	225.0 / 265.0	20.75 x 11.0 x 11.0	\$788.00	157.0
8G8D LTP (SAE Term)	703105	225.0 / 265.0	20.75 x 11.0 x 10.88	\$788.00	157.0
8A27 AGM	703107	92.0 / 106.0	12.75 x 6.88 x 9.88	\$286.00	63.0
8AU1 AGM	705182	33.0 / 38.0	8.31 x 5.13 x 7.25	\$104.00	24.0
8A31DT AGM	705183	105.0 / 121.0	12.94 x 6.75 x 9.75	\$328.00	70.0
8A4D LTP AGM	705181	200.0 / 230.0	20.75 x 8.5 x 10.0	\$612.00	129.0